


## ROADSIDE INLET

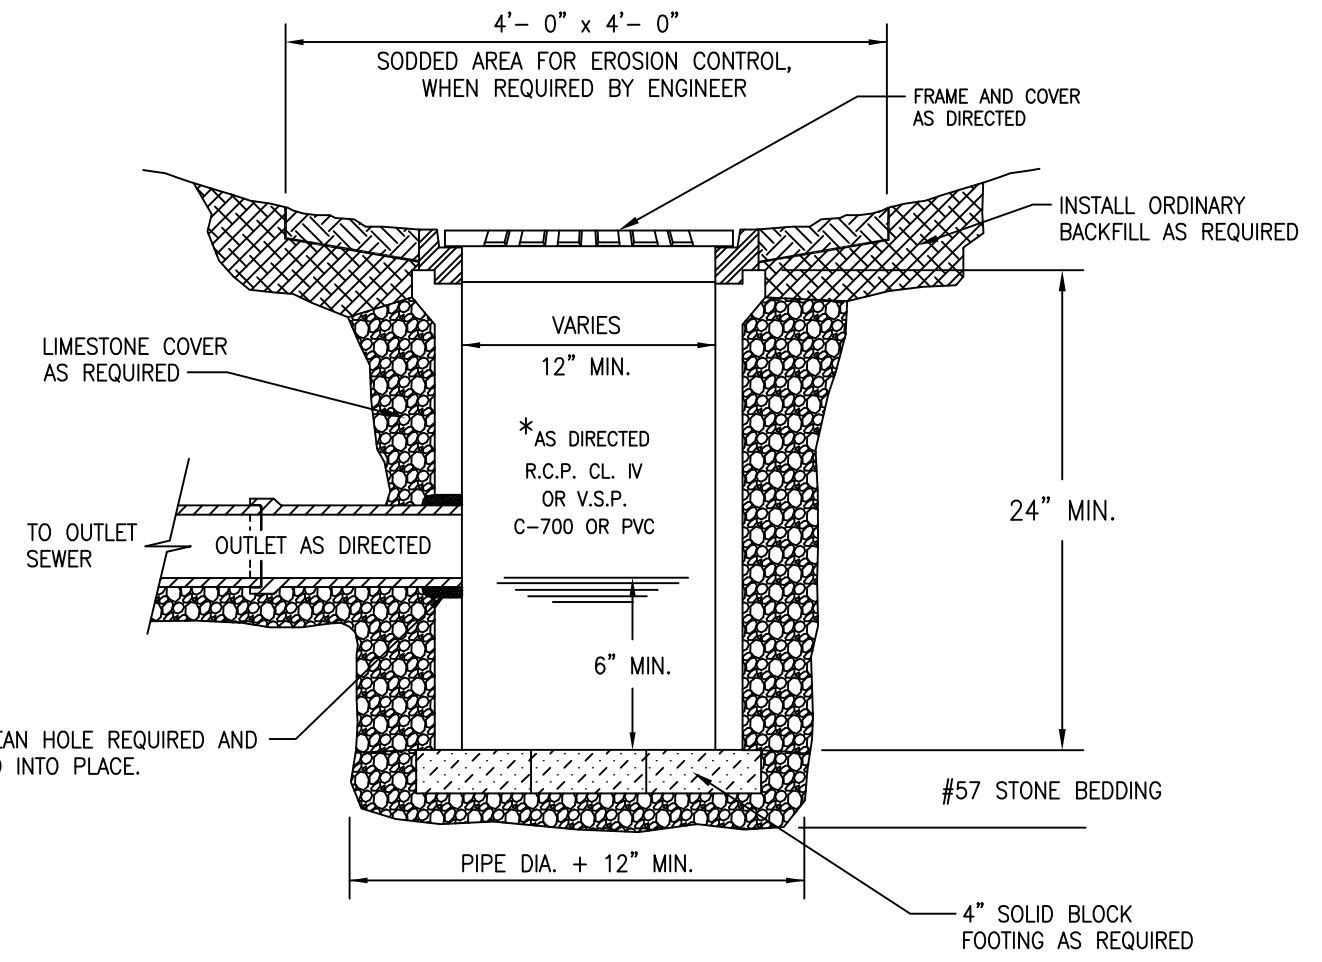

## YARD INLET GENERAL AREA

Notes:

Backfill for all structures within 5' of the pavement shall be Low Strength Mortar Backfill, TYPE 2 per current O.D.O.T. Construction and Material Specifications, except as modified herein.

**The use of Foundry Sand is strictly prohibited.**

The contractor is required to submit a mix design, for City Approval, a minimum of 48 hours prior to the installation of the backfill.

\*  
PIPE SIZE AS DIRECTED BY THE ENGINEER  
(MINIMUM 12")

CATALOG No.				
	**		**	PIPE SIZE
EAST JORDAN	EAST JORDAN	NEENAH	NEENAH	
6532	6012	R-4340-H	R-4030-12	12"
6533	6015	R-4340-G	R-4030-15	15"
6534	6018	R-4340-F1	R-4030-18	18"
6536	6024M1	R-4340-F	R-4030-24	24"

OTHER CASTINGS ACCEPTED UPON APPROVAL OF THE ENGINEER

\*\* INDICATES FLAT GRATE CATALOG No.

**FILTER FABRIC WILL BE INSTALLED IN ALL INLETS UNTIL GRASS ADJACENT TO THE INLET IS ESTABLISHED.**

REV No.	DATE	BY	DESCRIPTION
2	1/12/04	DAH	General Revisions - Re-Issue
1	10/9/01	DAH	FLAT CASTING ADDITIONS & AS DIRECTED STONE BASE

CITY OF WESTLAKE, OHIO  
DEPARTMENT OF ENGINEERING

## INLET DETAILS

SCALE:	AS NOTED	24
DATE:	DRWN BY:	