


All PVC pipe shall be ASTM 3034 SDR 23.5

TYPICAL CORE AND TEE DETAIL

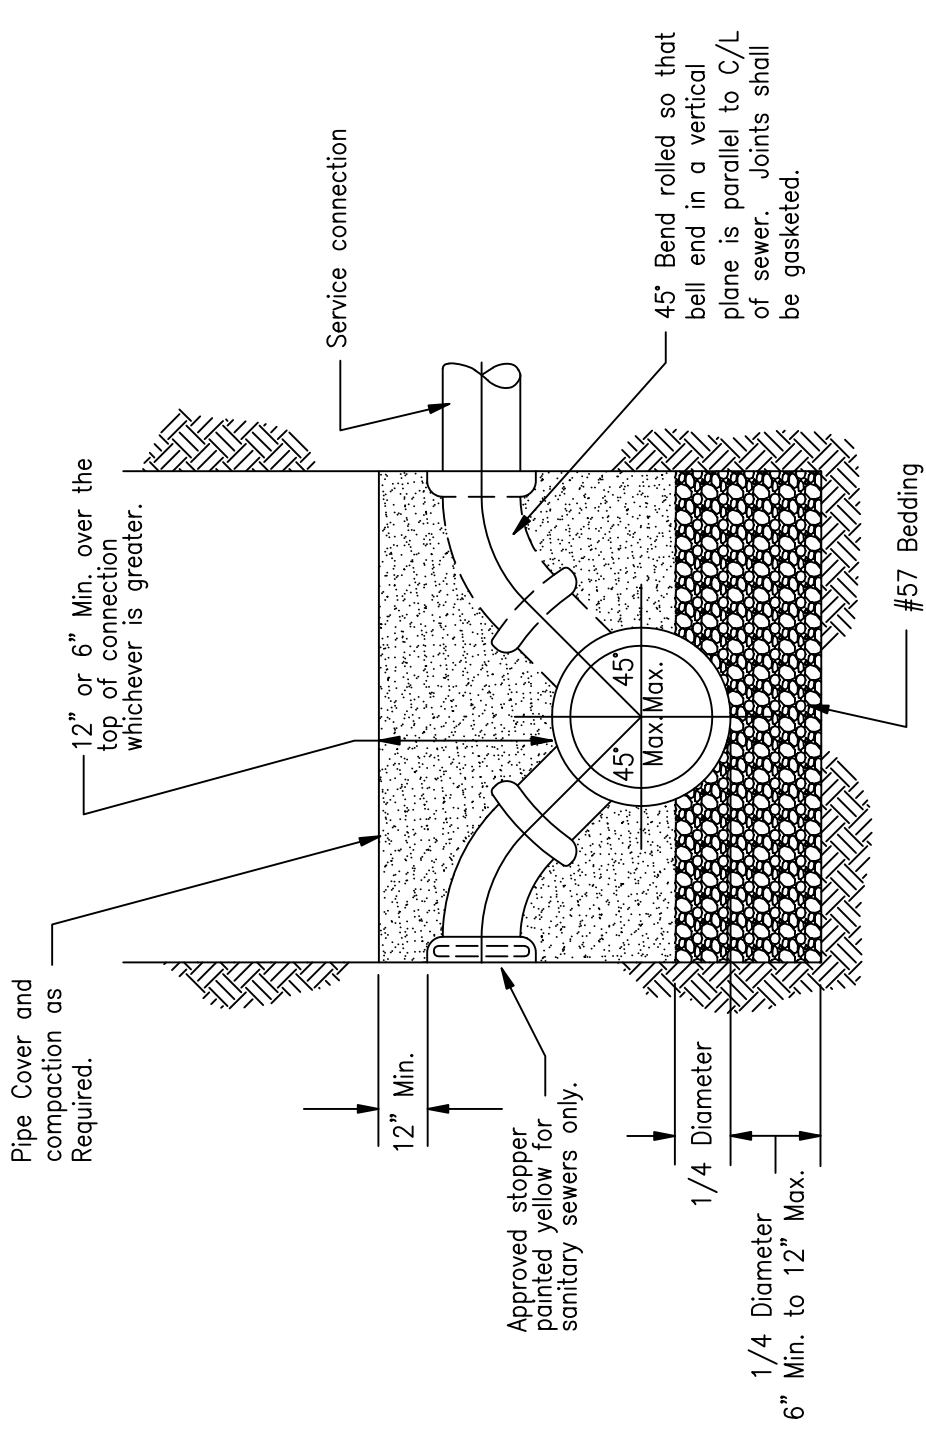

TYPICAL Y-BRANCH DETAIL

REV No.	DATE	BY	DESCRIPTION
2	8/12	DAH	General Revisions - Re-issue
1	2/17/04	DAH	General Revisions - Re-issue

CITY OF WESTLAKE, OHIO  
DEPARTMENT OF ENGINEERING

DETAILS  
SLANT & Y-BRANCH

SCALE:	AS NOTED	DRWN BY:	6
DATE:			